Noark

EMPOWERING SUSTAINABILITY

5/6/8kVA Installation Kit Example

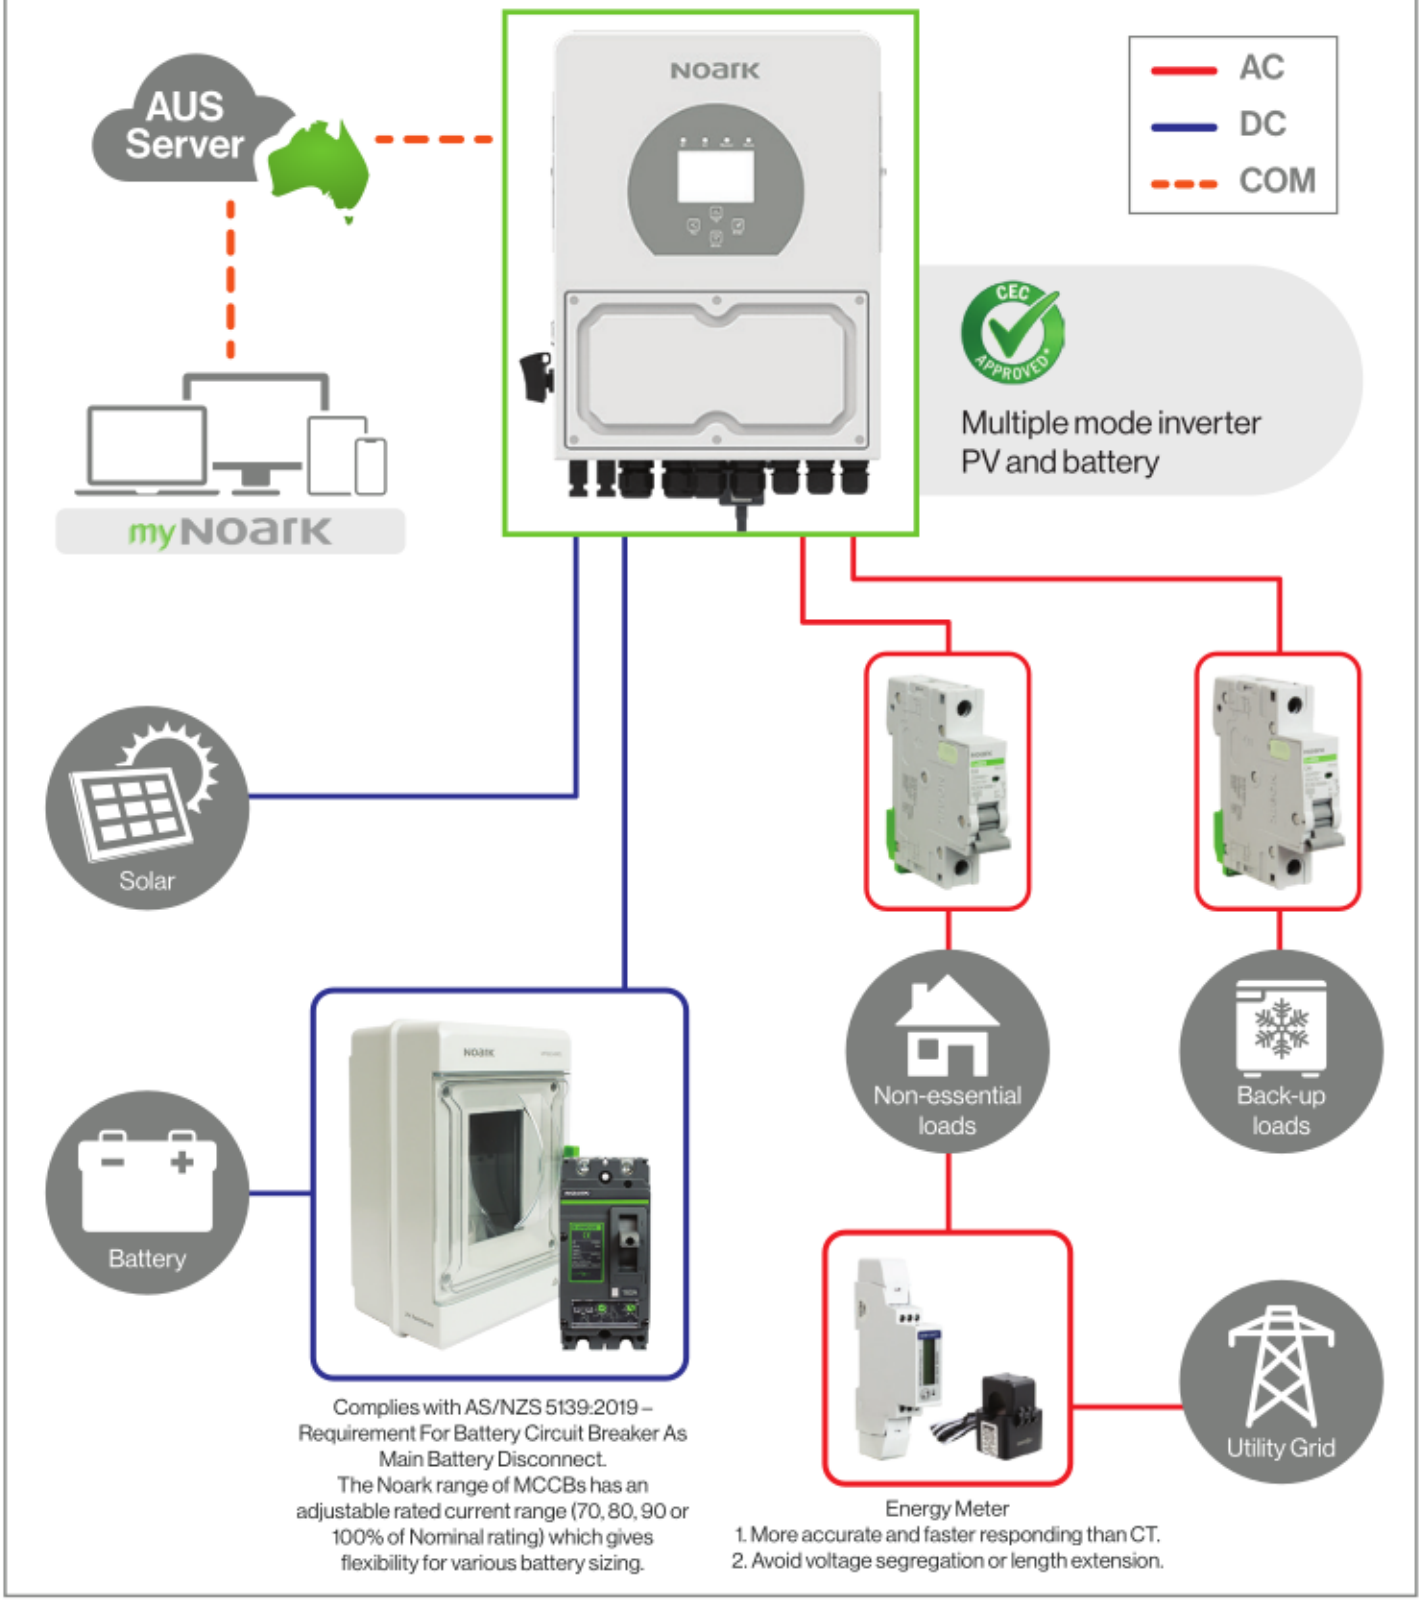

Complies with AS/NZS 5139:2019 – Requirement For Battery Circuit Breaker As Main Battery Disconnect.
The Noark range of MCCBs has an adjustable rated current range (70, 80, 90 or 100% of Nominal rating) which gives flexibility for various battery sizing.

Energy Meter
1. More accurate and faster responding than CT.
2. Avoid voltage segregation or length extension.